
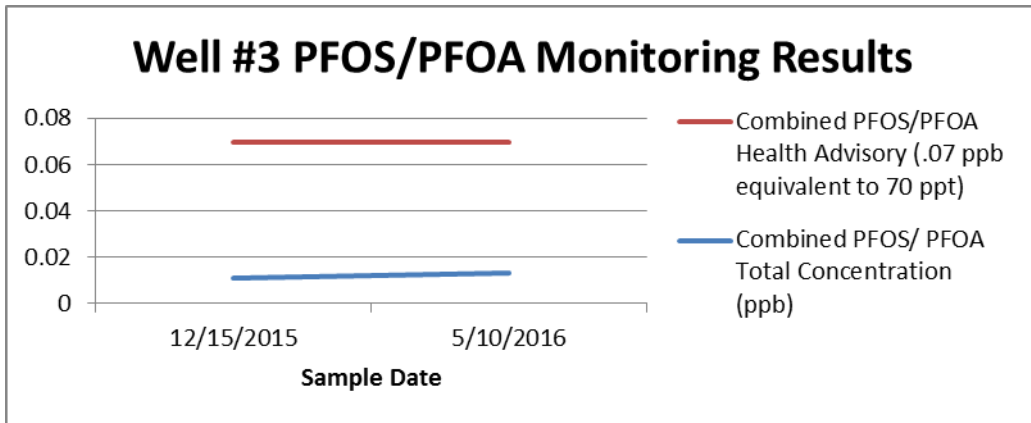
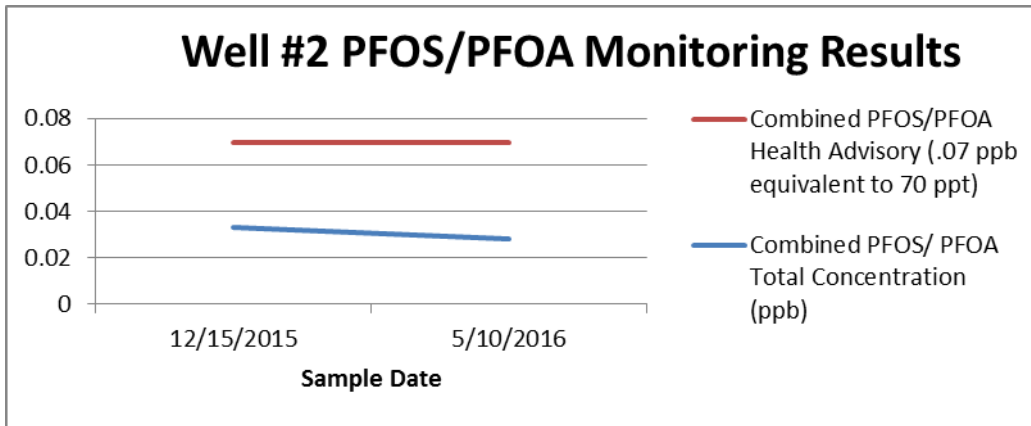





# PFOS/PFOA Monitoring Result Charts

These charts show these levels of PFOS/PFOA in the HWSA individual water supply wells based on monitoring conducted in December 2015 and May 2016. The red line is the EPA's lifetime health advisory level (set in May 2016). The blue line is the combined amount of PFOS and PFOA in the well. Note that the combined PFOS/PFOA levels are well below the EPA's lifetime health advisory level.

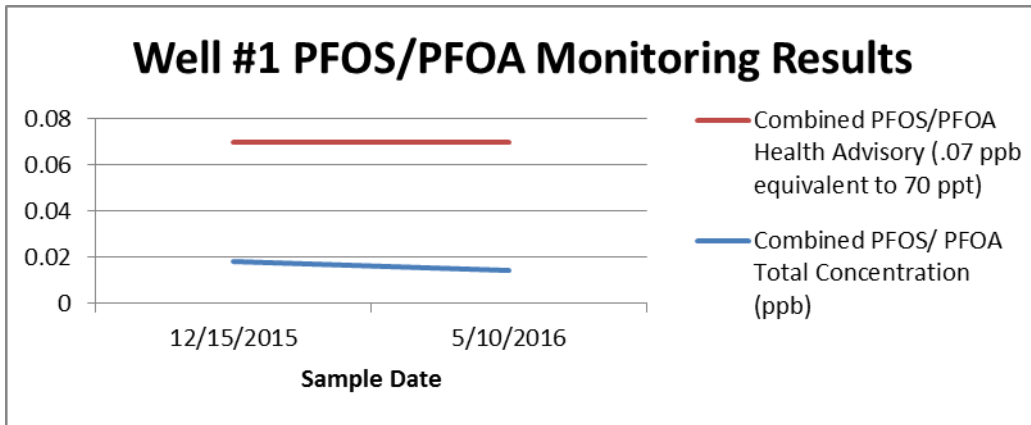

# PFOS/PFOA Monitoring Result Charts

These charts show these levels of PFOS/PFOA in the HWSA individual water supply wells based on monitoring conducted in December 2015 and May 2016. The red line is the EPA's lifetime health advisory level (set in May 2016). The blue line is the combined amount of PFOS and PFOA in the well. Note that the combined PFOS/PFOA levels are well below the EPA's lifetime health advisory level.

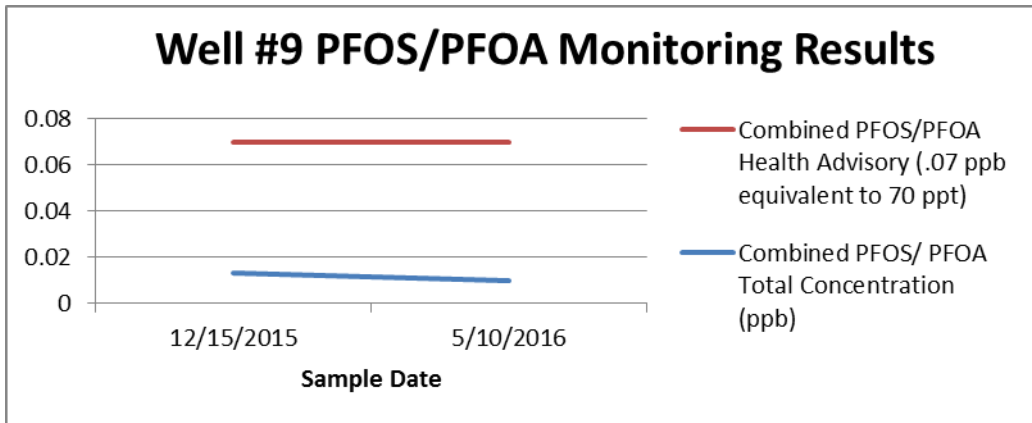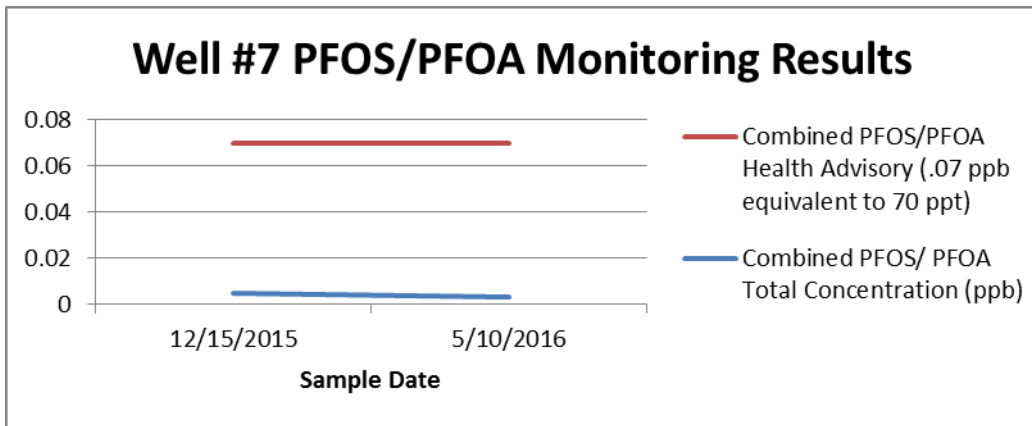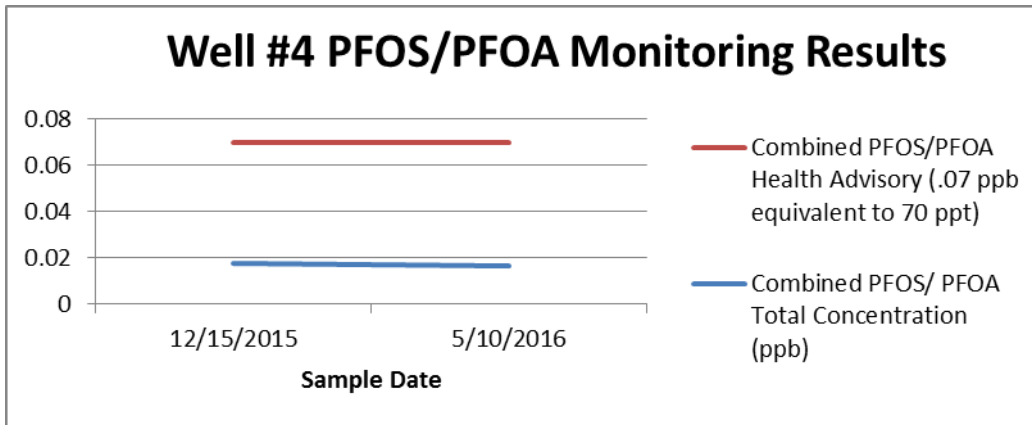

# PFOS/PFOA Monitoring Result Charts

These charts show these levels of PFOS/PFOA in the HWSA individual water supply wells based on monitoring conducted in December 2015 and May 2016. The red line is the EPA's lifetime health advisory level (set in May 2016). The blue line is the combined amount of PFOS and PFOA in the well. Note that the combined PFOS/PFOA levels are well below the EPA's lifetime health advisory level.

